


Access Door Control System Process Flow

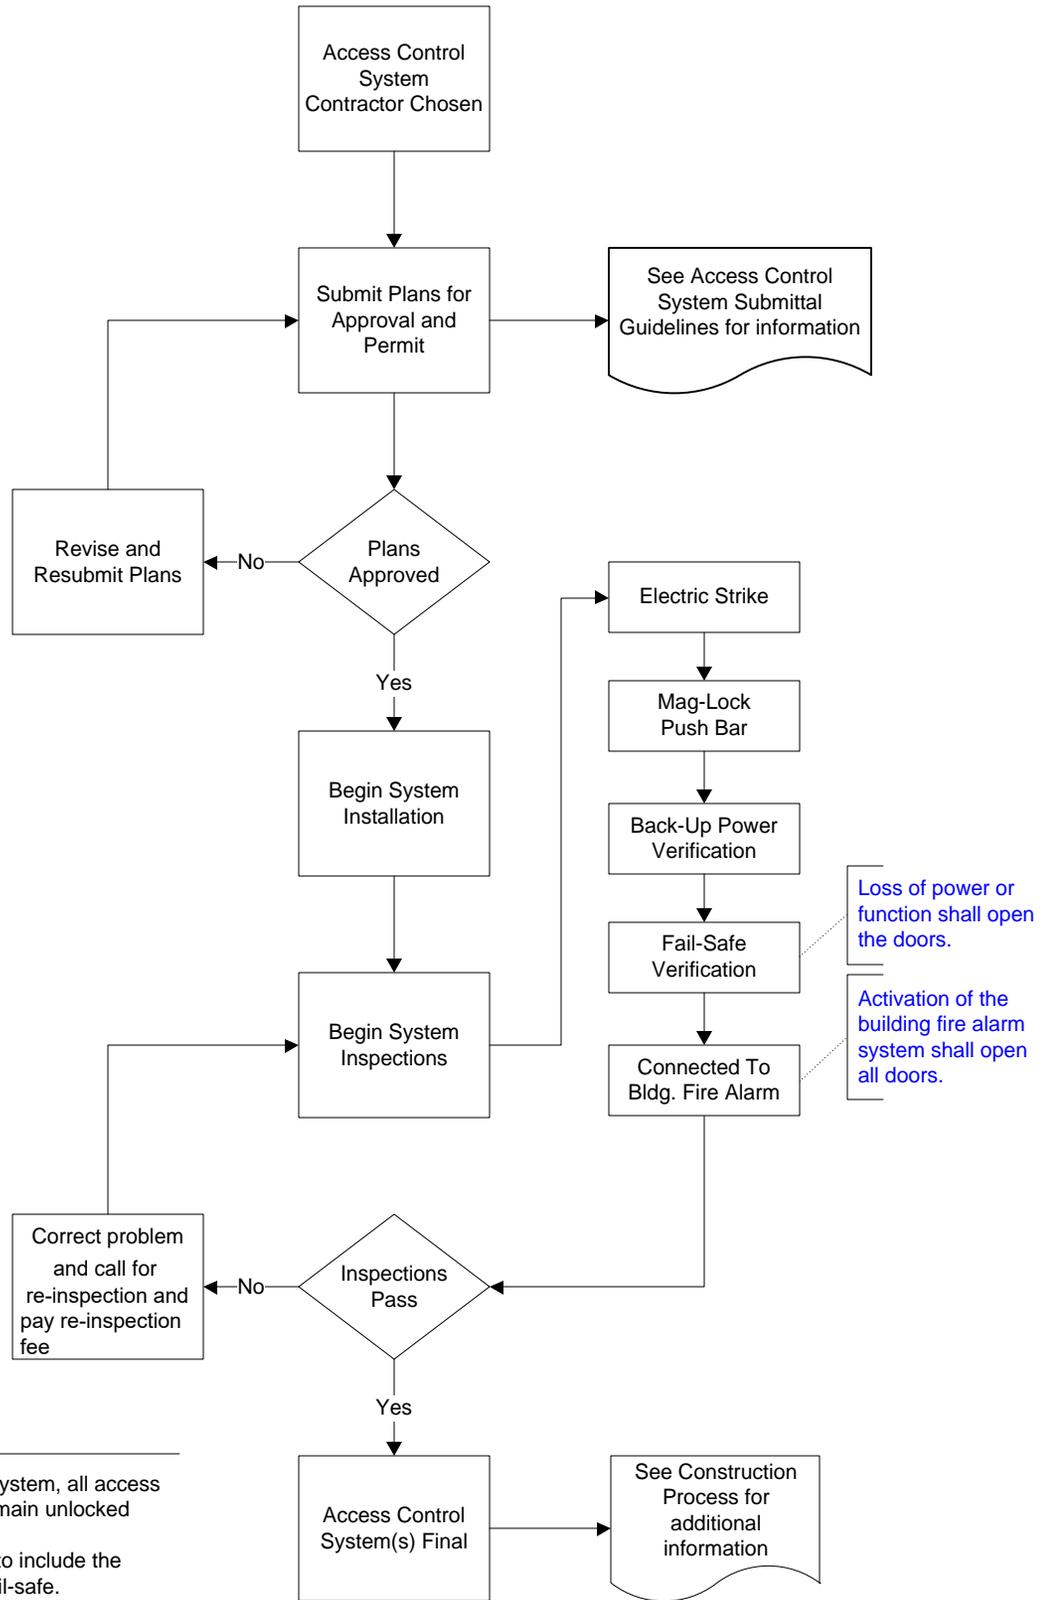

NOTES & SPECIFICATIONS

1. Upon activation of the fire alarm system, all access controlled doors shall unlock and remain unlocked until the fire alarm reset.
2. All wiring throughout the system, to include the pigtailed at the door jambs shall be fail-safe.